



Sodium Chlorite Wastewater Disinfection with Chlorine Dioxide

Introduction

Chlorine dioxide (ClO₂) is effective as both a disinfectant and an oxidant in wastewater treatment. It has several distinct chemical advantages compared to the traditional use of chlorine in wastewater treatment.

Chlorine dioxide is a broad-spectrum microbiocide effective over a wide pH range. Chlorine dioxide is non-reactive with ammonia and most nitrogen-containing compounds and is effective at lower dose levels than chlorine. It destroys phenolics, simple cyanides and sulfides by oxidation. For odor control, chlorine dioxide will oxidize sulfides without the formation of colloidal sulfur. It is also used to oxidize iron and manganese compounds.


Application Description

Chlorine dioxide is an extremely effective disinfectant and bactericide, equal or superior to chlorine on a mass dosage basis. Its efficacy has been well documented¹ in the laboratory, in pilot studies and in full-scale studies using potable and wastewater. Unlike chlorine, chlorine dioxide does not hydrolyze in water. Therefore, its germicidal activity is relatively constant over a broad pH range. At pH 6.5, doses of 0.25 mg/L of chlorine dioxide and chlorine produce comparable one-minute kill rates for the bacterium *Escherichia coli*. At pH 8.5, chlorine dioxide maintains that same kill rate, but chlorine requires five times as long. Thus, chlorine dioxide should be considered as a primary disinfectant for high pH, lime-softened waters.

Chlorine dioxide is as effective as chlorine in destroying coliform populations in wastewater effluents and is superior to chlorine in the treatment of viruses commonly found in

secondary wastewater effluents (Figure 4). When Poliovirus I and a native coliphage were subjected to these two disinfectants, a 2 mg/L dose of chlorine dioxide produced a much lower survival rate than did a 10 mg/L dose of chlorine². Chlorine dioxide has also been shown to be effective in killing other infectious bacteria such as *Staphylococcus aureus*, *Salmonella* and *Legionella*.

Figure 4
In situ coliphage survival in secondary effluent at three doses and three contact times

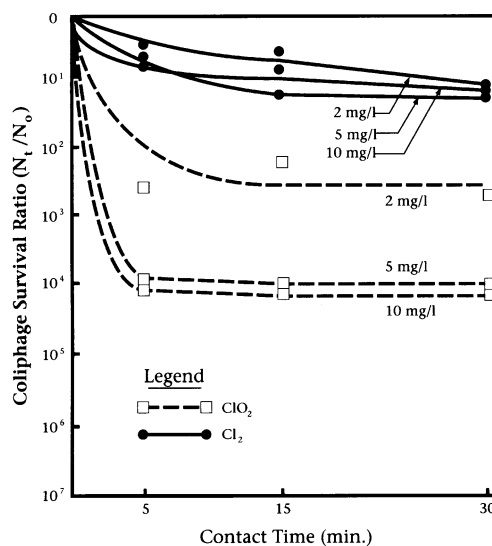

When applied for disinfection (as opposed to oxidation), a disinfectant must provide specified levels of microorganism kills or inactivations as measured by reductions of coliforms, heterotrophic plate count organisms.

Feed Requirements

The required dosages will vary with water conditions and the degree of contamination present. For most municipal and other





Basic Chemicals

wastewater systems, a chlorine dioxide residual concentration of up to 5 ppm is sufficient to provide adequate disinfection.

For sulfide odor control, between pH 5-9, a minimum of 5.2 ppm (wt) of chlorine dioxide should be applied to oxidize 1 ppm of sulfide (measured as sulfide ion). For phenol destruction, at pH less than 8, 1.5 ppm chlorine dioxide will oxidize 1 ppm phenol; at pH greater than 10, 3.3 ppm chlorine dioxide will oxidize 1 ppm phenol.

Method of Feed

Chlorine dioxide is a gas produced by activating sodium chlorite with an oxidizing agent or an acid source. Sodium chlorite is converted to chlorine dioxide through a chlorine dioxide generator and applied as a dilute solution. Chlorine dioxide solutions should be applied to the processing system at a point, and in a manner, which permits adequate mixing and uniform distribution. The feed point should be well below the water level to prevent volatilization of the chlorine dioxide. Avoid co-incident feeding of chlorine dioxide with lime or powdered activated carbon.

Chlorine Dioxide Analysis

Residual chlorine dioxide concentrations must be determined by substantiated methods, which are specific for chlorine dioxide. Two suitable methods are published in *Standard Methods for the Examination of Water and Wastewater*³:

4500-CIO₂ D DPD-Glycine Method
4500-CIO₂ E Amperometric Method II

Further Information

More detailed information on sodium chlorite is available on request through OxyChem Technical Service Department. Call or write to:

OxyChem Technical Service Department
6200 S. Ridge Rd.
Wichita, Kansas 67215
800-733-1165 option #1
OxyChem_Tech_Service@oxy.com

References

1. Aieta, E.M. and Berg, J.G., "A Review of Chlorine Dioxide in Drinking Water Treatment," *JAWWA*, 78:6:62 (June 1986).
2. Roberts, P.V., Aieta, E.M., Berg, J.D., and Chow, B.M., "Chlorine Dioxide for Wastewater Disinfection: A Feasibility Evaluation," Stanford University, EPA-600/281-092 (1981).
3. *Standard Methods for the Examination of Water and Wastewater*, APHA, AWWA and WEF, Washington, D.C. (20th Ed. 1998).

600-507 Sodium Chlorite 08/2022



Wichita Technical Service Department
6200 South Ridge Road, Wichita, KS 67215
Tel: 800-733-1165 ext. 1
OxyChem_Tech_Service@oxy.com

Important: The information presented herein, while not guaranteed, was prepared by technical personnel and is true and accurate to the best of our knowledge. NO WARRANTY OF MERCHANTABILITY OR OF FITNESS FOR A PARTICULAR PURPOSE, OR WARRANTY OR GUARANTY OF ANY OTHER KIND, EXPRESS OR IMPLIED, IS MADE REGARDING PERFORMANCE, SAFETY, SUITABILITY, STABILITY OR OTHERWISE. This information is not intended to be all-inclusive as to the manner and conditions of use, handling, storage, disposal, and other factors that may involve other or additional legal, environmental, safety or performance considerations, and Occidental Chemical Corporation assumes no liability whatsoever for the use of or reliance upon this information. While our technical personnel will be happy to respond to questions, safe handling and use of the product remains the responsibility of the customer. No suggestions for use are intended as, and nothing herein shall be construed as, a recommendation to infringe any existing patents or to violate any Federal, State, local or foreign laws.